

MCS-SR Temp Solar

EasySens Motion sensor

thermokon[®]
HOME OF SENSOR TECHNOLOGY

Datasheet

Subject to technical alteration
Issue date: 05.11.2025 • A143



» APPLICATION

EasySens- compact multi sensor with temperature detection intended for living and office spaces. The device can be mounted using adhesive tape (included) or screws and transmits the measured values to receivers or gateways.

This product is intended for use as part of an automation solution for (functional) buildings. It transmits sensor data within a building over short distances unencrypted by radio to suitable receivers. No personal data or location data is transmitted.

The product cannot communicate directly with the Internet and is not intended for applications that use the Internet to forward unprocessed sensor data. Automation stations that forward data via the Internet, e.g. to visualise the building status, must ensure that the data to be forwarded is encrypted as required by law.

» SECURITY ADVICE – CAUTION

The installation and assembly of the device should only be performed by authorized personnel.



The product should only be used for the intended application. Unauthorised modifications are prohibited! The product must not be used in relation with any equipment that in case of a failure may threaten, directly or indirectly, human health or life or result in danger to human beings, animals or assets. Ensure all power is disconnected before installing. Do not connect to live/operating equipment.

Please comply with:

- Local laws, health & safety regulations, technical standards and regulations
- Condition of the device at the time of installation, to ensure safe installation
- This data sheet and installation manual

» ENOCEAN BASIC INFORMATION

Enocean Geräte werden nicht für die Verwendung im Zusammenhang mit Sicherheitsfunktionen empfohlen.

When designing enocean networks, always consider the local limitations, damping of radio signals and required communication paths. **Walls, furniture, objects and even the human bodies damp signals.** Perform a signal range test before mounting enocean devices and design in a buffer for the signal. Enocean devices are not recommended for the use in context with safety functions.

» PRODUCT TESTING AND CERTIFICATION



Declaration of conformity

The declaration of conformity of the products are available on our website
<https://www.thermokon.de/direct/en-gb/categories/mcs>

» GUIDELINES FOR DEVICES WITH SOLAR ENERGY STORAGE

Due to the energy-optimized EnOcean radio technology used in "EasySens[®]" wireless sensors, the devices can work without batteries and self-charge themselves using electric energy generated by integrated solar cells. This makes the devices almost maintenance free and environmentally sound due to not having to replace batteries.

For optimum use, the device should be mounted in a location with sufficient ambient brightness. Minimum illumination of 200 lx (artificial light or ambient) is required for at least 3 to 4 hours each day. (The health and safety regulations at work require a minimum illumination of 500 lx for office workplaces).

The solar cell should be mounted facing towards the window direction if possible. If the device has a temperature sensor, then even periodic direct sun radiation should be avoided due to incorrect false temperature readings.

The mounting position should be selected so that the device will not be obstructed in the future: for example by placement areas, additional furniture or roll-fronted cupboards.

The sensor is supplied in an operational state. If the sensor has been stored in darkness for longer periods, the internal solar energy storage will most likely need to be recharged. This would normally happen automatically during commissioning or during initial start up in ambient light. If the initial charge is not sufficient, the sensor will reach its full operating state up to 3 to 4 days, if the requirements for minimum illumination per day are met. The sensor will then transmit continuously in darkness as specified f (2/3 days on factory default telegram timing). Depending on the application it is also possible for the devices to operate in darker rooms (with brightness <100 lx) by using the battery back-up option. Batteries to be used are listed in accessories.

The operating time when using batteries will depend on the transmission frequency as well as the component aging and the self-discharge of the battery. Standard operating time will be several years on factory default telegram timing. Changing of the device from solar to battery operation is done automatically by simply adding a battery to the device.

» INFORMATION ABOUT EASYSSENS[®] (RADIO) / AIRCONFIG GENERAL USAGE



EasySens[®] - airConfig

Basic information about EasySens[®] radio and about general usage of our airConfig software, please download from our website. <https://www.thermokon.de/direct/files/airconfig-software-manual.zip>

» OVERVIEW OF THE RADIO TELEGRAMS



EEP

The structure of the data contained in the telegram can be found in the EEP (EnOcean equipment profile) list provided by the EnOcean Alliance.

» MOUNTING ADVISE ROOM SENSORS

The Accuracy of the room sensors are influenced by the technical specifications as well as the positioning and the installation type.

During Assembly:

- Seal mounting box (if present).
- Installation type, air draught, heat source, radiation heat or direct sunlight can affect the measurement.
- Bulding material specific properties of the installation place (*brick-, concrete-, partition wall, cavity wall, ...*) can affect the measurement.

Assembly not recommendet in...

- Air draught (e.g.: close to windows / doors / fans ...)
- Near heating sources,
- Direct sunlight
- Niches / between furniture / ...




» TECHNISCHE DATA

Measuring values	Temperature + relative humidity	
Radio technology	EnOcean (IEC 14543-3-10), transmission power <10 mW (EEP A5-02-05)	
Frequency <i>(type dependent)</i>	868 MHz	902 MHz
Antenna	internal transmitting/receiving antenna	
Power supply	solar cell, internal super cap, maintenance-free	
Measuring range temp	0..+40 °C 32..+104 °F	
Accuracy temperature	±0,4 K (typ. at 21 °C 70 °F)	
Sending interval	every 100 sec. at change >0,8 K, otherwise every 1000 sec.	
Enclosure	PC V0, pure white or anthracite (optional)	
Protection	IP20 according to DIN EN 60529	
Ambient condition	0..+40 °C 32..+104 °F , max. 85% rH non-condensing	
Mounting	to be mounted flat onto the surface using adhesive foil (already mounted on bottom cover) or screws (Holes for countersunk screws Ø 3 mm in the lower cover)	

» COMISSIONING


Before mounting, the device check the radio signal strength (RSSI) at the receiver position. The radio signal needs to be sufficient for the receiver. The device can be mounted via the adhesive tape already mounted, or optionally with screws

» Device Opening

Bottom View		Top View	
	Push lower cover laterally .		Move device laterally to the left (observe arrow symbol orientation!)
	Remove cover		Remove top section

» TEACH-IN

By default, a 1BS teach-in telegram is transmitted by pressing the Learn button (opened device). Press the key on the back to trigger a teach-in telegram. The teach-in telegram identifies the device manufacturer, the function and the type of the device. *The jumper remains in position 1 in the connector strip for the teach-in process and operation of the device (see illustration).*

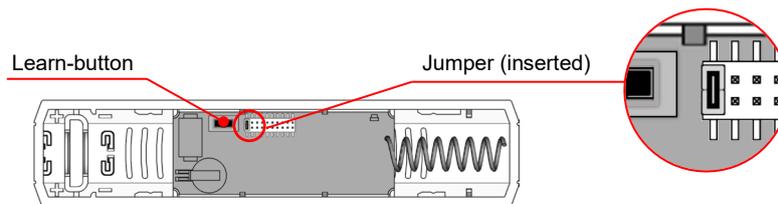

» OPERATION MODES SRW03

Type	Info
MCS-SR Temp Solar	Mode 3 „Transport“ upon delivery, commissioning when switching

» Change mode 3 „transport“ to mode 1 „standard“


Press learn button (for 1s)
radio module switches to mode 1 (standard).
(LED flashes once and a (standard) learn-telegram is transmitted)

» Change mode 1 „standard“ to Mode 2 „secure“

Long Press learn button twice (press 5s, pause <1s, press 5s)
radio module switches to mode 2 (Secure).
(LED flashes twice and a „secure“ learn-telegram is transmitted)

» Change mode 1 / mode 2 to mode 3 „transport“

Press learn button (5s)
radio module switches in mode 3 (transport).
(LED flashes 3 times and a transport-signal-telegram is transmitted)

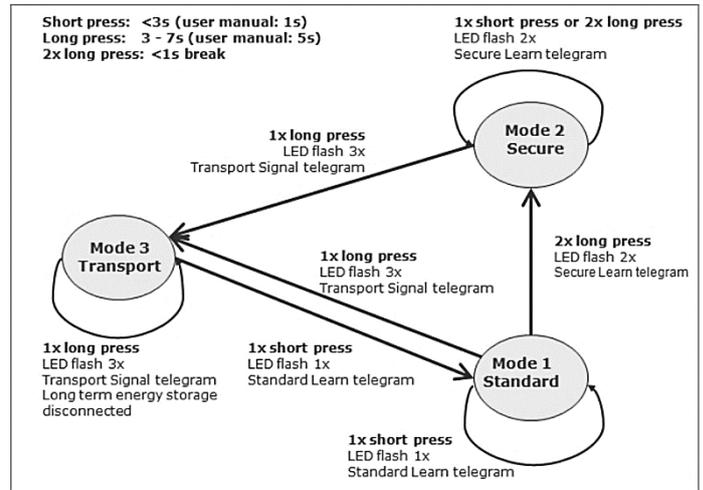

» ENERGY STATUS (SIGNAL TELEGRAM)


An energy status message (signal telegram) is sent at 6-hour intervals.

Signal telegrams (SIG) can be received with an STC65+ Modbus (from V4.7.0), STC-Bacnet IP (from V3.0.3.4) or a STC-IoT Gateway and evaluated by the superior control unit (BMS).

Telegram content

Offset	Size	Data	Shortcut	Description	
0	8	Message index	MID	Enumeration: 0x06 – Energy status of the device	
8	8	Energy	ERG	Description	
				Telegram (SIG)	
				0..100 %	
				100: Energy level good	hex(06 64)
				1: Energy level low	hex(06 01)
				0: Energy level critical	hex(06 00)

» DIMENSIONS (MM)

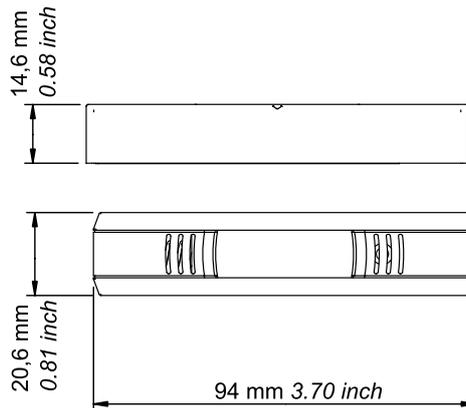

» NOTES ON DISPOSAL



The crossed-out wheeled bin symbol indicates that the product or removable batteries must not be disposed of with household or commercial waste. Within the EU, you are legally obliged to dispose of the product separately and appropriately in accordance with the national laws of your country. Alternatively, please contact your supplier or Thermokon Sensortechnik GmbH. Further information can be found at: www.thermokon.com